## FAN COIL UNIT SCHEDULE

| CODE | MFR | MODEL | SUPPLY FAN | | | | ELECTRICAL | | | COOLING COIL | | | | | | HEATING COIL | | | HT W/O LEVELING | WEIGHT (LBS) | AREAS SERVED/ FLOOR | COMMENTS |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | | CFM | OSA | RPM | ESP (in) | BHP | V/PH | MCA | MOCP | EAT °F DB | EAT °F WB | LAT °F DB | CAPACITY (MBH) TOTAL | SENS | EAT °F DB | LAT °F DB | CAP MBH | | | | |
| FC-1 | COMPU-AIRE | MKA212E | 900 | 0 | MED | - | - | 208/1 | 7 | 15 | 80 | 67 | 57 | 29.8 | 22.1 | - | - | 0.0 | 24 | 250 | ELEV. MACH. RM | |
| FC-2 | COMPU-AIRE | MKA212E | 900 | 0 | MED | - | - | 208/1 | 7 | 15 | 80 | 67 | 57 | 29.8 | 22.1 | - | - | 0.0 | 24 | 250 | ELECTRICAL RM | |
| FC-3 | COMPU-AIRE | MKA212E | 900 | 0 | MED | - | - | 208/1 | 7 | 15 | 80 | 67 | 57 | 29.8 | 22.1 | - | - | 0.0 | 24 | 250 | ELEV. MACH. RM | |

## CONDENSING UNIT

| CODE | MFR. | MODEL | SUCTION TEMP | REFR | V/PH | MCA | MOCP | WT. (LBS) | HT. W/O LEVELING | HOT GAS BYPASS | LOW AMB. CONTROL | CRTS. | EQUIP. SERVED | COMMENTS |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| CU-1 | COMPU-AIRE | MKA212C | 40 | R-22 | 208/1 | 22.6 | 35 | 300 | 24 | N | Y | 1 | FC-1 | 1 |
| CU-2 | COMPU-AIRE | MKA212C | 40 | R-22 | 208/1 | 22.6 | 35 | 300 | 24 | N | Y | 1 | FC-2 | 1 |
| CU-3 | COMPU-AIRE | MKA212C | 40 | R-22 | 208/1 | 22.6 | 35 | 300 | 24 | N | Y | 1 | FC-3 | 1 |

1 LOW AMBIANT

## FAN SCHEDULE

| CODE | MFR | MODEL | CFM | ESP (in) | RPM | BHP | MOTOR HP | V/PH | HT. W/O ISOLATORS | WEIGHT (LBS) | AREAS SERVED | COMMENTS |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| EF-1 | GREENHECK | QEP | 30,000 | 0.40 | 580 | 5.60 | 7.50 | 208/3 | 58 | 600 | MECHANICAL AREA | |
| SF-1 | GREENHECK | BCF-108-4 | 1,000 | 0.30 | 830 | 0.15 | 0.25 | 115/1 | 16 | 120 | RETAIL AREA | |

## LOUVER SCHEDULE

| CODE | LOCATION | HEIGHT | WIDTH | CFM | PRESS. DROP | WT | P/N | MFG. | REMARKS |
|---|---|---|---|---|---|---|---|---|---|
| L-1 | GROUND LEVEL | 18 | 66 | 3,000 | 0.1 | 74 | L6375D | RUSKIN | |
| L-2 | GROUND LEVEL | 24 | 24 | 1,000 | 0.1 | 36 | L6375D | RUSKIN | |
| L-3 | GROUND LEVEL | 78 | 96 | 30,000 | 0.1 | 468 | L6375D | RUSKIN | |
| L-4 | SECOND LEVEL | 42 | 96 | 15,000 | 0.1 | 252 | L6375D | RUSKIN | |
| L-5 | GROUND LEVEL | 18 | 36 | - | - | 41 | L6375D | RUSKIN | |

## PLUMBING FIXTURE SCHEDULE

| CODE | DESCRIPTION | MIN. ROUGH-IN CONN (IN) | | | | LOCATION | REMARKS |
|---|---|---|---|---|---|---|---|
| | | W | V | CW | HW | | |
| AD-1 | AREA DRAIN | 6" | — | — | — | SEE FLR PLAN | 6" TO STORM DRAIN |
| AD-2 | AREA DRAIN | 4" | — | — | — | SEE FLR PLAN | 4" TO STORM DRAIN |
| FD-1 | FLOOR DRAIN | 3" | 1-1/2" | — | — | SEE FLR PLAN | W/ TP CONNECTION |
| GI-1 | GREASE INTERCEPTOR | 4" | — | — | — | SEE FLR PLAN | JENSEN PRECAST 2000 EE |
| HB-1 | HOSE BIBB | — | — | 3/4" | — | SEE FLR PLAN | |
| SFU-1 | STORM FILTER | 10" | — | — | — | SEE FLR PLAN | 10" TO STORM DRAIN |

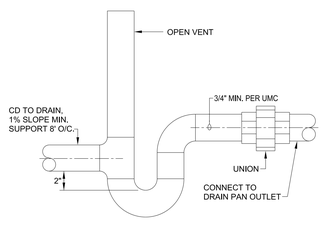


3 M0.1 BLOW THROUGH CONDENSATE DRAIN CONNECTION
NO SCALE SEE PLAN VIEW

PRELIMINARY FOR REVIEW PURPOSES ONLY

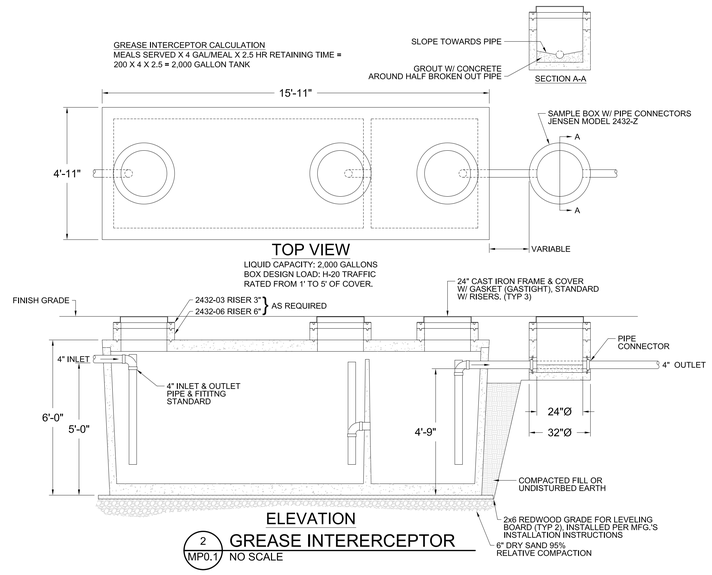


2 MP0.1 GREASE INTERERCEPTOR
NO SCALE

## SYMBOLS & ABBREVIATIONS (PLUMBING)

- BALANCING COCK
- BALL VALVE
- CAP
- CHECK VALVE
- CLEANOUT
- COLD WATER PIPING (DCW)
- DIRECTION OF FLOW
- FLANGED UNION
- FLOOR DRAIN (FD)
- FLOOR SINK (FS)
- FORCE MAIN (FM)
- GAS COCK
- GATE VALVE
- GLOBE VALVE
- HIGH PRESSURE GAS PIPING (HPG)
- HOSE BIBB (3/4" MIN.)
- HOT WATER PIPING (DHW)
- HOT WATER RETURN PIPING (DHWR)
- LOW PRESSURE GAS PIPING (G)
- PETES PLUG (PP)
- PIPE HANGER
- PIPE TURNING UP (RISE)
- PIPE TURNING DOWN (DROP)
- PIPE TEE DOWN
- PRESSURE REDUCING VALVE
- P & T RELIEF VALVE
- POINT OF CONNECTION TO EXISTING (POC)
- EXTENT OF DEMOLITION (POD)
- RAIN WATER LEADER (RWL)
- REDUCER
- ROOF DRAIN (RD)
- (E) STORM DRAIN (SD)
- (N) STORM DRAIN (SD)
- STRAINER
- SUB-SOIL PIPING
- UNION
- VENT PIPING (V)
- (E) WASTE PIPING (W)
- (N) WASTE PIPING (W)
- (N) WASTE PIPING - UNDERGROUND
- (N) GREASE WASTE (GW)
- WATERHAMMER ARRESTOR (WHA)
- TRAP PRIMER (TP)

| | |
|---|---|
| AFF | ABOVE FINISHED FLOOR |
| BV | BALL VALVE |
| CB | CATCH BASIN |
| CFH | CUBIC FEET PER HOUR |
| CI | CAST IRON |
| DCW | COLD WATER |
| DCV | DETECTOR CHECK VALVE |
| DN | DOWN |
| DS | DOWN SPOUT |
| DSP | DRY STAND PIPE |
| (E) | EXISTING |
| EC | ELECTRICAL CONTRACTOR |
| EL | ELEVATION |
| FC | FLEX CONNECTOR |
| FCO | FLOOR CLEANOUT |
| FDC | FIRE DEPARTMENT CONNECTION |
| FD | FLOOR DRAIN |
| FSC | FIRE SPRINKLER CONTRACTOR |
| GC | GENERAL CONTRACTOR |
| GCO | GRADE CLEANOUT |
| GPM | GALLONS PER MINUTE |
| GPR | GAS PRESSURE REGULATOR |
| GM | GAS METER |
| HB | HOSE BIBB |
| IE | INVERT ELEVATION |
| LAV | LAVATORY |
| MC | MECHANICAL CONTRACTOR |
| NPW | NON POTABLE WATER |
| (N) | NEW |
| OD | OVERFLOW DRAIN |
| PC | PLUMBING CONTRACTOR |
| PIV | POST INDICATION VAVLE |
| PRV | PRESSURE REDUCING VALVE |
| PVC | POLYVINYL CHLORIDE PIPE |
| RD | ROOF DRAIN |
| RPBFP | REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTER |
| SD | STORM DRAIN |
| SOV | SHUT-OFF VALVE |
| SS | SANITARY SEWER |
| TP | TRAP PRIMER |
| UCD | UNDER CUT DOOR |
| V | VENT |
| VIF | VERIFY IN FIELD |
| VTR | VENT THRU ROOF |
| W | WASTE |
| WC | WATER CLOSET |
| WCO | WALL CLEANOUT |
| WH | WATERHEATER |
| WHA | WATER HAMMER ARRESTOR |
| WM | WATERMETER |

## GENERAL PLUMBING NOTES:

1. ENTIRE INSTALLATION SHALL CONFORM TO THE REQUIREMENTS OF THE 2001 CALIFORNIA PLUMBING CODE, INCLUDING THE CALIFORNIA ENERGY CONSERVATION STANDARDS OF TITLE 24.
2. ALL EQUIPMENT SHALL BE INSTALLED IN STRICT ACCORDANCE WITH THE EQUIPMENT MANUFACTURER'S RECOMMENDATIONS. PROVIDE ALL FITTINGS, TRANSITIONS, VALVES, AND OTHER DEVICES REQUIRED FOR A COMPLETE WORKABLE INSTALLATION.
3. PIPES SHALL BE SUPPORTED AND BRACED PER SMACNA "GUIDELINES FOR SEISMIC RESTRAINTS OF MECHANICAL SYSTEMS AND PLUMBING PIPING SYSTEMS."
4. COORDINATE PLUMBING SYSTEMS WITH WORK OF OTHER TRADES PRIOR TO ANY FABRICATION OR INSTALLATION. PROVIDE ALL FITTINGS, OFFSETS, AND TRANSITIONS AS REQUIRED FOR A COMPLETE WORKABLE INSTALLATION.
5. PENETRATIONS OF RATED ASSEMBLIES SHALL BE FIRE STOPPED BY AN APPROVED MATERIAL AS PRESCRIBED IN UBC STANDARD 7-5.
6. REFER TO STRUCTURAL DRAWING FOR LOCATIONS OF BEAMS, SHEAR WALLS AND MEMBERS. ALL DRILLING OF STRUCTURAL BEAMS AND MEMBERS TO BE COORDINATED WITH THE STRUCTURAL ENGINEER. ALL HOLES SHALL BE MINIMUM SIZE AND APPROVED BY STRUCTURAL ENGINEER PRIOR TO DRILLING. CONTRACTOR SHALL BE RESPONSIBLE FOR X-RAY OF ANY POST TENSIONED CONCRETE AND APPROVALS FOR PENETRATION.
7. P.C. SHALL PROVIDE CONCRETE INSERTS FOR HANGING MECH. EQUIPMENT, COORD. W/ G.C.
8. PROVIDE 8'-2" CLEAR UNDER ALL PIPING IN AREAS OF VEHICLE TRAVEL.
9. MINIMUM 3' COVER OVER ALL UNDERGROUND PIPING.

## SYMBOLS & ABBREVIATIONS (MECHANICAL)

- BYPASS TIMER
- CENTER LINE
- CONDENSATE DRAIN
- (N) EXHAUST AIR DUCT
- FIRE/SMOKE DAMPER
- HORIZONTAL FIRE DAMPER
- RETURN OR EXHAUST AIR
- ROUND
- SECTION THRU EXHAUST
- SECTION THRU RETURN
- SECTION THRU SUPPLY
- SPEED CONTROL SWITCH
- SPINWIN EXTRACTOR/DAMPER
- SUPPLY OR OUTSIDE AIR
- (N) SUPPLY/RETURN AIR DUCT
- THERMOSTAT at + 48"
- TRANSFER AIR
- TURNING VANES (TV)
- VERTICAL FIRE DAMPER
- VOLUME DAMPER

| | |
|---|---|
| AD | ACCESS DOOR |
| AFF | ABOVE FINISHED FLOOR |
| AL | ACOUSTICALLY LINED |
| AP | ACCESS PANEL |
| BD | BALANCING DAMPER |
| BDD | BACKDRAFT DAMPER |
| BHP | BRAKE HORSEPOWER |
| BTU | BRITISH THERMAL UNIT |
| C | CONDUIT |
| CD | CONDENSATE DRAIN |
| CFM | CUBIC FEET PER MINUTE |
| DL | DOOR LOUVER |
| (E) | EXISTING |
| EA | EXHAUST AIR |
| EAD | EXHAUST AIR DUCT |
| EC | ELECTRICAL CONTRACTOR |
| EDB | ENTERING DRY BULB |
| EWB | ENTERING WET BULB |
| °F | DEGREES FAHRENHEIT |
| FC | FLEXIBLE CONNECTION |
| FD | FIRE DAMPER |
| FLA | FULL LOAD AMPS |
| FSD | FIRE SMOKE DAMPER |
| FT.HD. | FEET HEAD |
| FTR | FLUE THRU ROOF |
| GC | GENERAL CONTRACTOR |
| HP | HORSE POWER |
| KW | KILOWATTS |
| LBS | POUNDS |
| MBH | 1000 BTU/HR |
| MC | MECHANICAL CONTRACTOR |
| (N) | NEW |
| NIC | NOT IN CONTRACT |
| NTS | NOT TO SCALE |
| OBD | OPPOSED BLADE DAMPER |
| OSA | OUTSIDE AIR |
| PD | PRESSURE DROP |
| PH | PHASE |
| P/N | PART NUMBER |
| PRV | PRESSURE REDUCING VALVE |
| PSI | POUNDS PER SQUARE INCH |
| P/T | PRESSURE/TEMPERATURE |
| RA | RETURN AIR |
| RAD | RETURN AIR DUCT |
| (RL) | RELOCATE |
| RPM | REVOLUTIONS PER MINUTE |
| RWL | RAIN WATER LEADER |
| SA | SUPPLY AIR |
| SAD | SUPPLY AIR DUCT |
| SD | STORM DRAIN |
| SP | STATIC PRESSURE |
| SS | STAINLESS STEEL |
| STD | STANDARD |
| TV | TURNING VANES |
| TYP | TYPICAL |
| UCD | UNDERCUT DOOR |
| UON | UNLESS OTHERWISE NOTED |
| V | VOLT |
| VD | VOLUME DAMPER |
| W/ | WITH |
| WC | WATER COLUMN |
| WSP | WET STAND PIPE |
| WT | WEIGHT |
| W/O | WITH OUT |
| VIF | VERIFY IN FIELD |

## GENERAL MECHANICAL NOTES:

1. ENTIRE INSTALLATION SHALL CONFORM TO THE REQUIREMENTS OF THE 2001 CALIFORNIA MECHANICAL CODE, INCLUDING THE CALIFORNIA ENERGY CONSERVATION STANDARDS OF TITLE 24.
2. ALL EQUIPMENT SHALL BE INSTALLED IN STRICT ACCORDANCE WITH THE EQUIPMENT MANUFACTURER'S RECOMMENDATIONS. PROVIDE ALL FITTINGS, TRANSITIONS, DAMPERS, VALVES, AND OTHER DEVICES REQUIRED FOR A COMPLETE WORKABLE INSTALLATION.
3. ALL DUCTWORK SHALL BE CONSTRUCTED, ERECTED, AND TESTED IN ACCORDANCE WITH THE APPLICABLE SMACNA STANDARDS.
4. DUCTWORK SHALL BE SUPPORTED AND BRACED PER SMACNA "GUIDELINES FOR SEISMIC RESTRAINTS OF MECHANICAL SYSTEMS AND PLUMBING PIPING SYSTEMS."
5. PENETRATIONS OF RATED ASSEMBLIES SHALL BE FIRE STOPPED BY AN APPROVED MATERIAL AS PRESCRIBED IN UBC STANDARD 7-5.
6. REFER TO STRUCTURAL DRAWING FOR LOCATIONS OF BEAMS, SHEAR WALLS AND MEMBERS. ALL DRILLING OF STRUCTURAL BEAMS AND MEMBERS TO BE COORDINATED WITH THE STRUCTURAL ENGINEER. ALL HOLES SHALL BE MINIMUM SIZE AND APPROVED BY STRUCTURAL ENGINEER PRIOR TO DRILLING. CONTRACTOR SHALL BE RESPONSIBLE FOR X-RAY OF ANY POST TENSIONED CONCRETE AND APPROVALS FOR PENETRATION.
7. M.C. SHALL PROVIDE CONCRETE INSERTS FOR HANGING MECH. EQUIPMENT, COORD. W/ G.C.

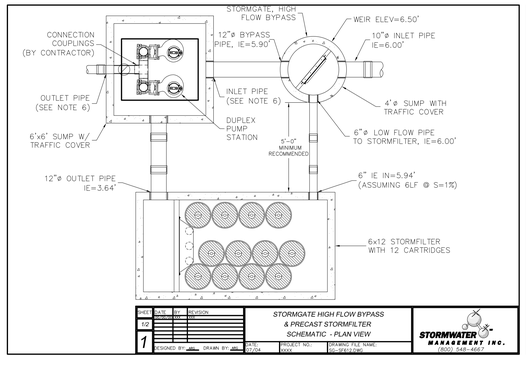


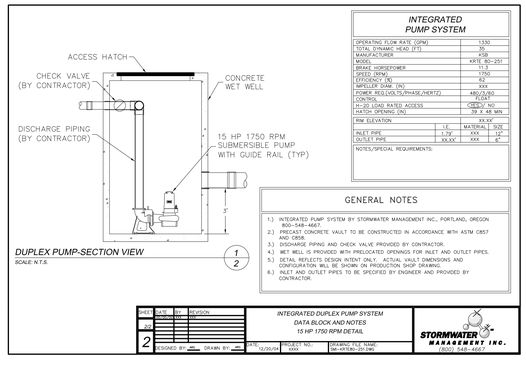


1 MP0.1 STORM FILTER, BYPASS & PUMP STATION
NO SCALE

## DRAWING INDEX:


| | |
|---|---|
| MP 0.1 | SYMBOLS, ABBREVIATIONS, SCHEDULES AND NOTES |
| MP 2.1 | GROUND LEVEL MECHANICAL AND PLUMBING PLAN |
| MP 2.2 | SECOND LEVEL MECHANICAL AND PLUMBING PLAN |
| MP 2.3 | THIRD LEVEL MECHANICAL AND PLUMBING PLAN |
| MP 2.4 | FOURTH LEVEL MECHANICAL AND PLUMBING PLAN |
| MP 2.5 | FIFTH LEVEL MECHANICAL AND PLUMBING PLAN |



Architects • Engineers • Parking Planners

WATRY DESIGN, INC.

1700 Seaport Blvd, Suite 210
Redwood City, California 94063
Tel: 650.298.8150
Fax: 650.298.8151
E-mail: wdi@watrydesign.com
www.watrydesign.com

LIST ENGINEERING COMPANY
9699 Blue Larkspur Lane
Suite 203
Monterey, CA 93940
Telephone 831.373.4390
Facsimile 831.373.6522
Job No. - 03001.00



© LEC 2005
PD021105
© WATRY DESIGN, INC. 2005


NOT FOR CONSTRUCTION

SYMBOLS, ABBREVIATIONS, SCHEDULES & NOTES

MOUNTAIN VIEW PARKING STRUCTURE
MOUNTAIN VIEW, CALIFORNIA

REVISIONS

| NO. | DATE | BY |
|---|---|---|
| | | |

02-24-05
80% WORKING DOCUMENTS

| | | |
|---|---|---|
| JOB NO | : | 02044 |
| DATE | : | 12-06-04 |
| DESIGN | : | J. CANTER |
| DRAWN | : | D. CUSTIS |
| CHECKED BY | : | R. BLUE |
| FILE NAME | : | MP0.1.DWG |

SHEET

MP0.1


\\Lecserv-2\CAD\PROJECTS\2003\03001\MP0.1.dwg, 2/22/2005 9:26:35 AM, daniel

\\Laserv-2\CAD\PROJECTS\2003\03001\MP2.1.dwg, 2/22/2005 9:25:57 AM, daniel

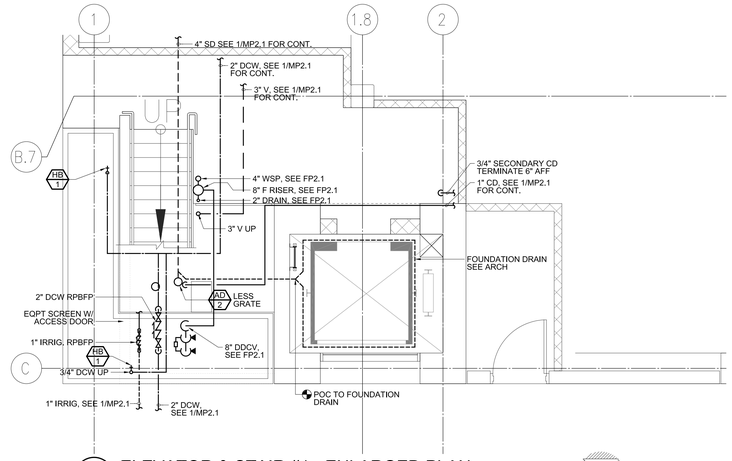


2 MP2.1 ELEVATOR & STAIR #1 - ENLARGED PLAN
SCALE:1/4"=1'-0"

## SHEET NOTE

1. PROVIDE LOUVER FOR FUTURE TOILET ROOM EXHAUST FAN.
2. CAP 3/4" GAS ABOVE FLOOR FOR FUTURE GM CONNECTION. SLEEVE GAS LINE.
3. 2" DCW DN TO MANIFOLD FOR (3) FUTURE WMS ON WALL.
4. NOT USED
5. NOT USED
6. CAP EXHAUST UNTIL T.I. THIS LOUVER WAS OVER SIZED COMPARED TO THE EXPECTED EMPLOYEE REST ROOM EXHAUST. THIS LOUVER IS FOR UP TO THREE TENANTS. IF TI IS DONE IN PHASES, THE FIRST PHASE SHOULD LEAVE ROOM FOR THE OTHER PHASES.
7. PLUG OUTLET / INLET AND FILL FULL OF WATER.

© WATRY DESIGN, INC. 2003

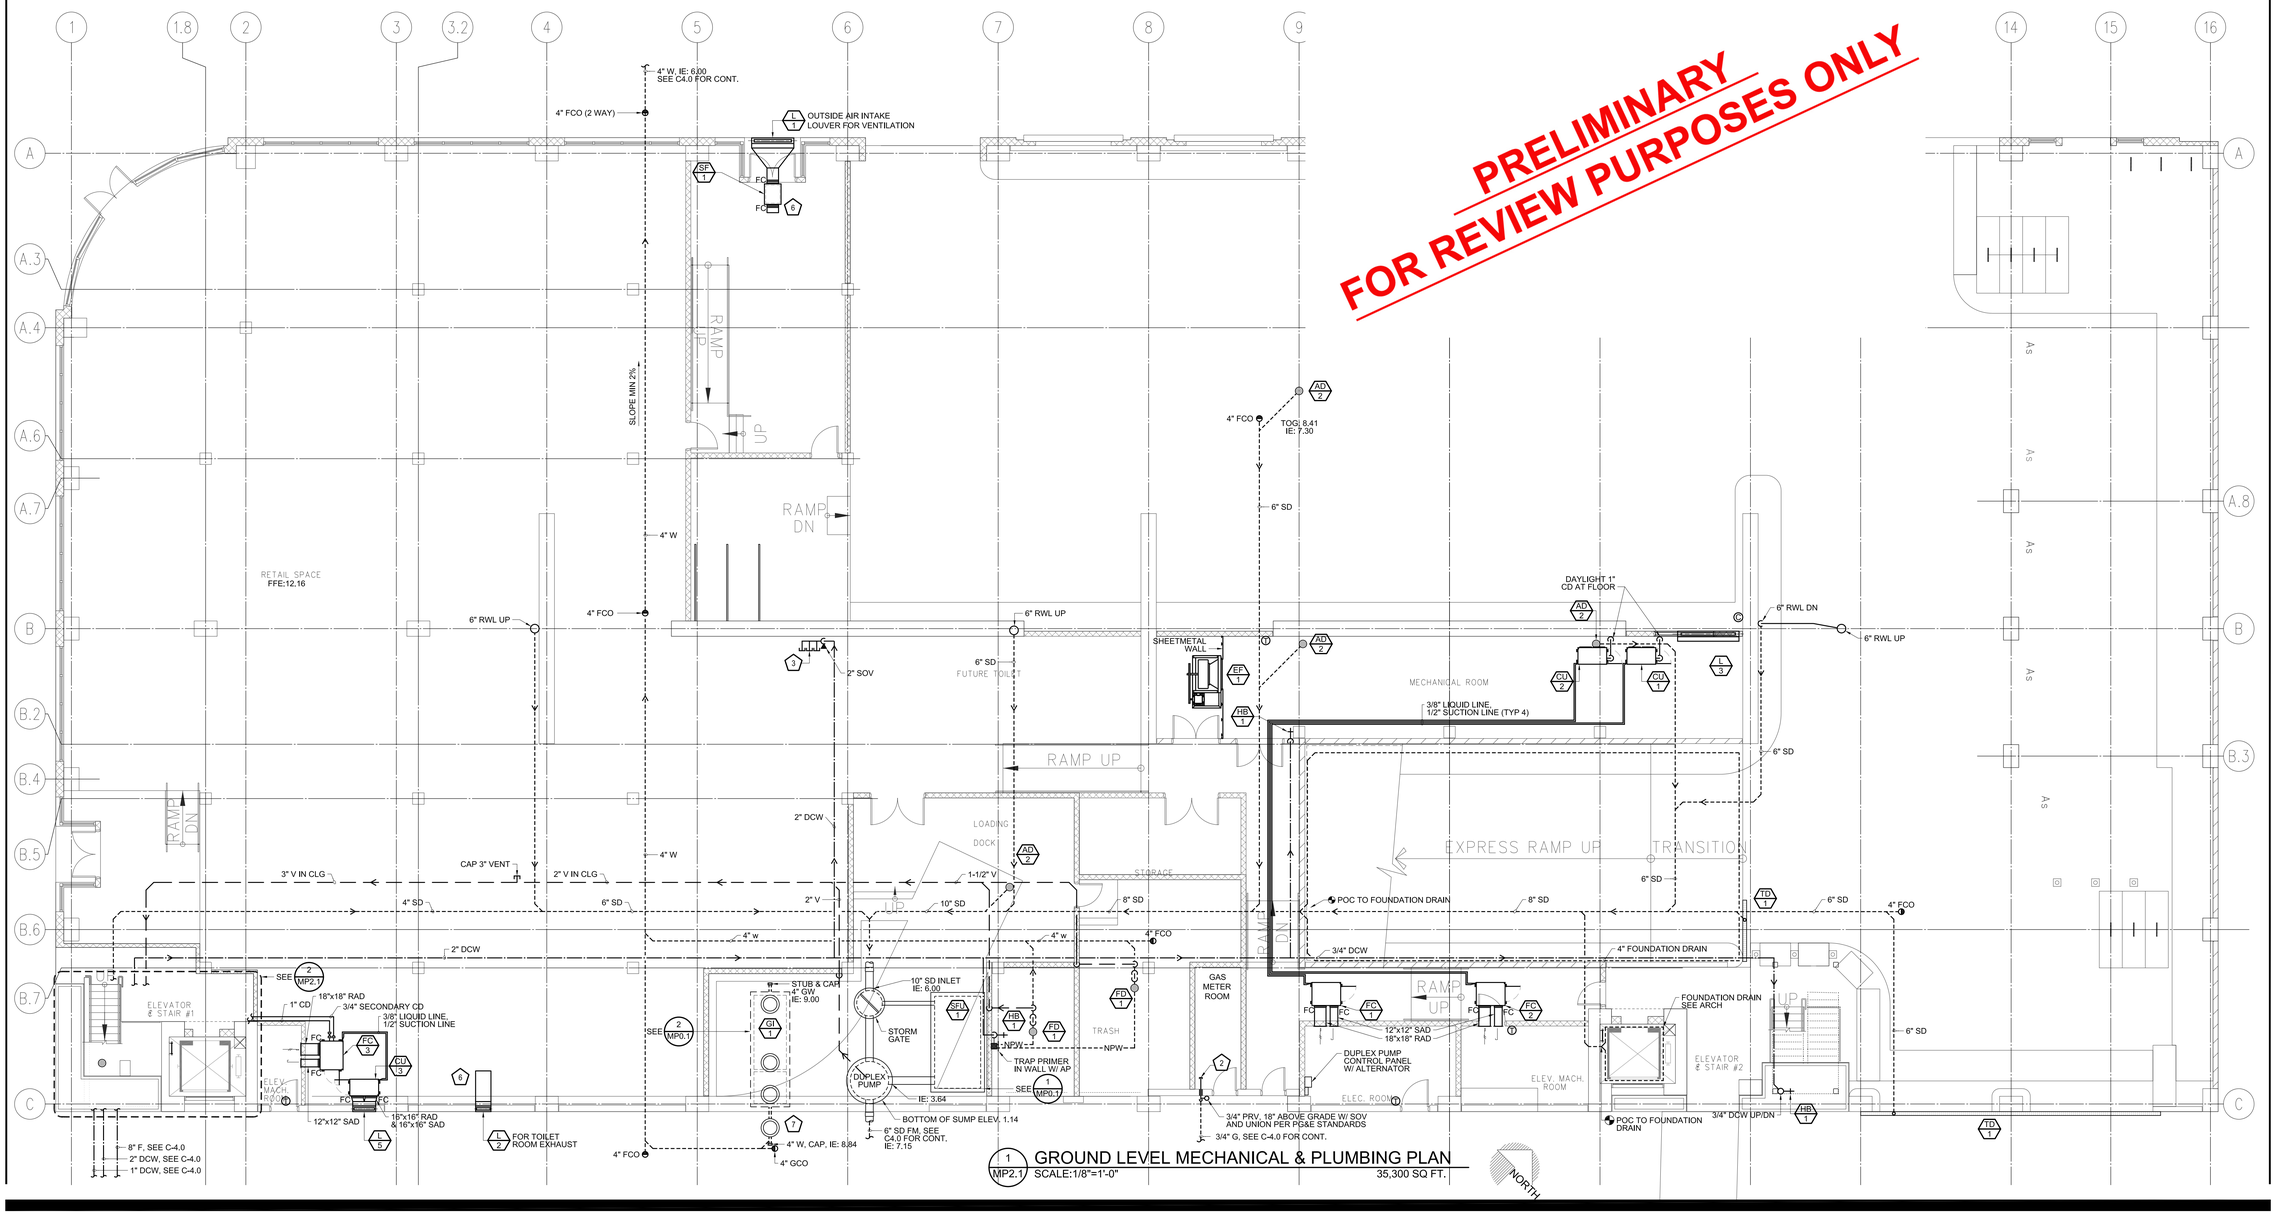


1 MP2.1 GROUND LEVEL MECHANICAL & PLUMBING PLAN
SCALE:1/8"=1'-0"
35,300 SQ FT.

PRELIMINARY
FOR REVIEW PURPOSES ONLY

Architects • Engineers • Parking Planners

WATRY DESIGN, INC.

1700 Seaport Blvd, Suite 210
Redwood City, California 94063
Tel: 650.298.8150
Fax: 650.298.8151
E-mail: wdi@watrydesign.com
www.watrydesign.com

LIST ENGINEERING COMPANY
9699 Blue Larkspur Lane
Suite 203
Monterey, CA 93940
Telephone 831.373.4390
Facsimile 831.373.6522
Job No. - 03001.00

© LEC 2005

PD021105

NOT FOR CONSTRUCTION

GROUND LEVEL MECHANICAL & PLUMBING PLAN

# MOUNTAIN VIEW PARKING STRUCTURE

MOUNTAIN VIEW, CALIFORNIA

| REVISIONS | | |
|---|---|---|
| NO. | DATE | BY |
| | | |

02-24-05
80% WORKING DOCUMENTS

| | | |
|---|---|---|
| JOB NO | : | 02044 |
| DATE | : | 12-06-04 |
| DESIGN | : | J. CANTER |
| DRAWN | : | D. CUSTIS |
| CHECKED BY | : | R. BLUE |
| FILE NAME | : | MP2.1.DWG |

SHEET

MP2.1

\\lacsrv-2k\CAD\PROJECTS\2003\03011\MP2.2.dwg, 2/22/2005 9:25:26 AM, daniel

SHEET NOTE

1. TRANSITION AT 30° TO LOUVERS. HANG DUCT TIGHT TO BOTTOM OF FLOOR ABOVE.

© WATRY DESIGN, INC. 2003

PRELIMINARY
FOR REVIEW PURPOSES ONLY

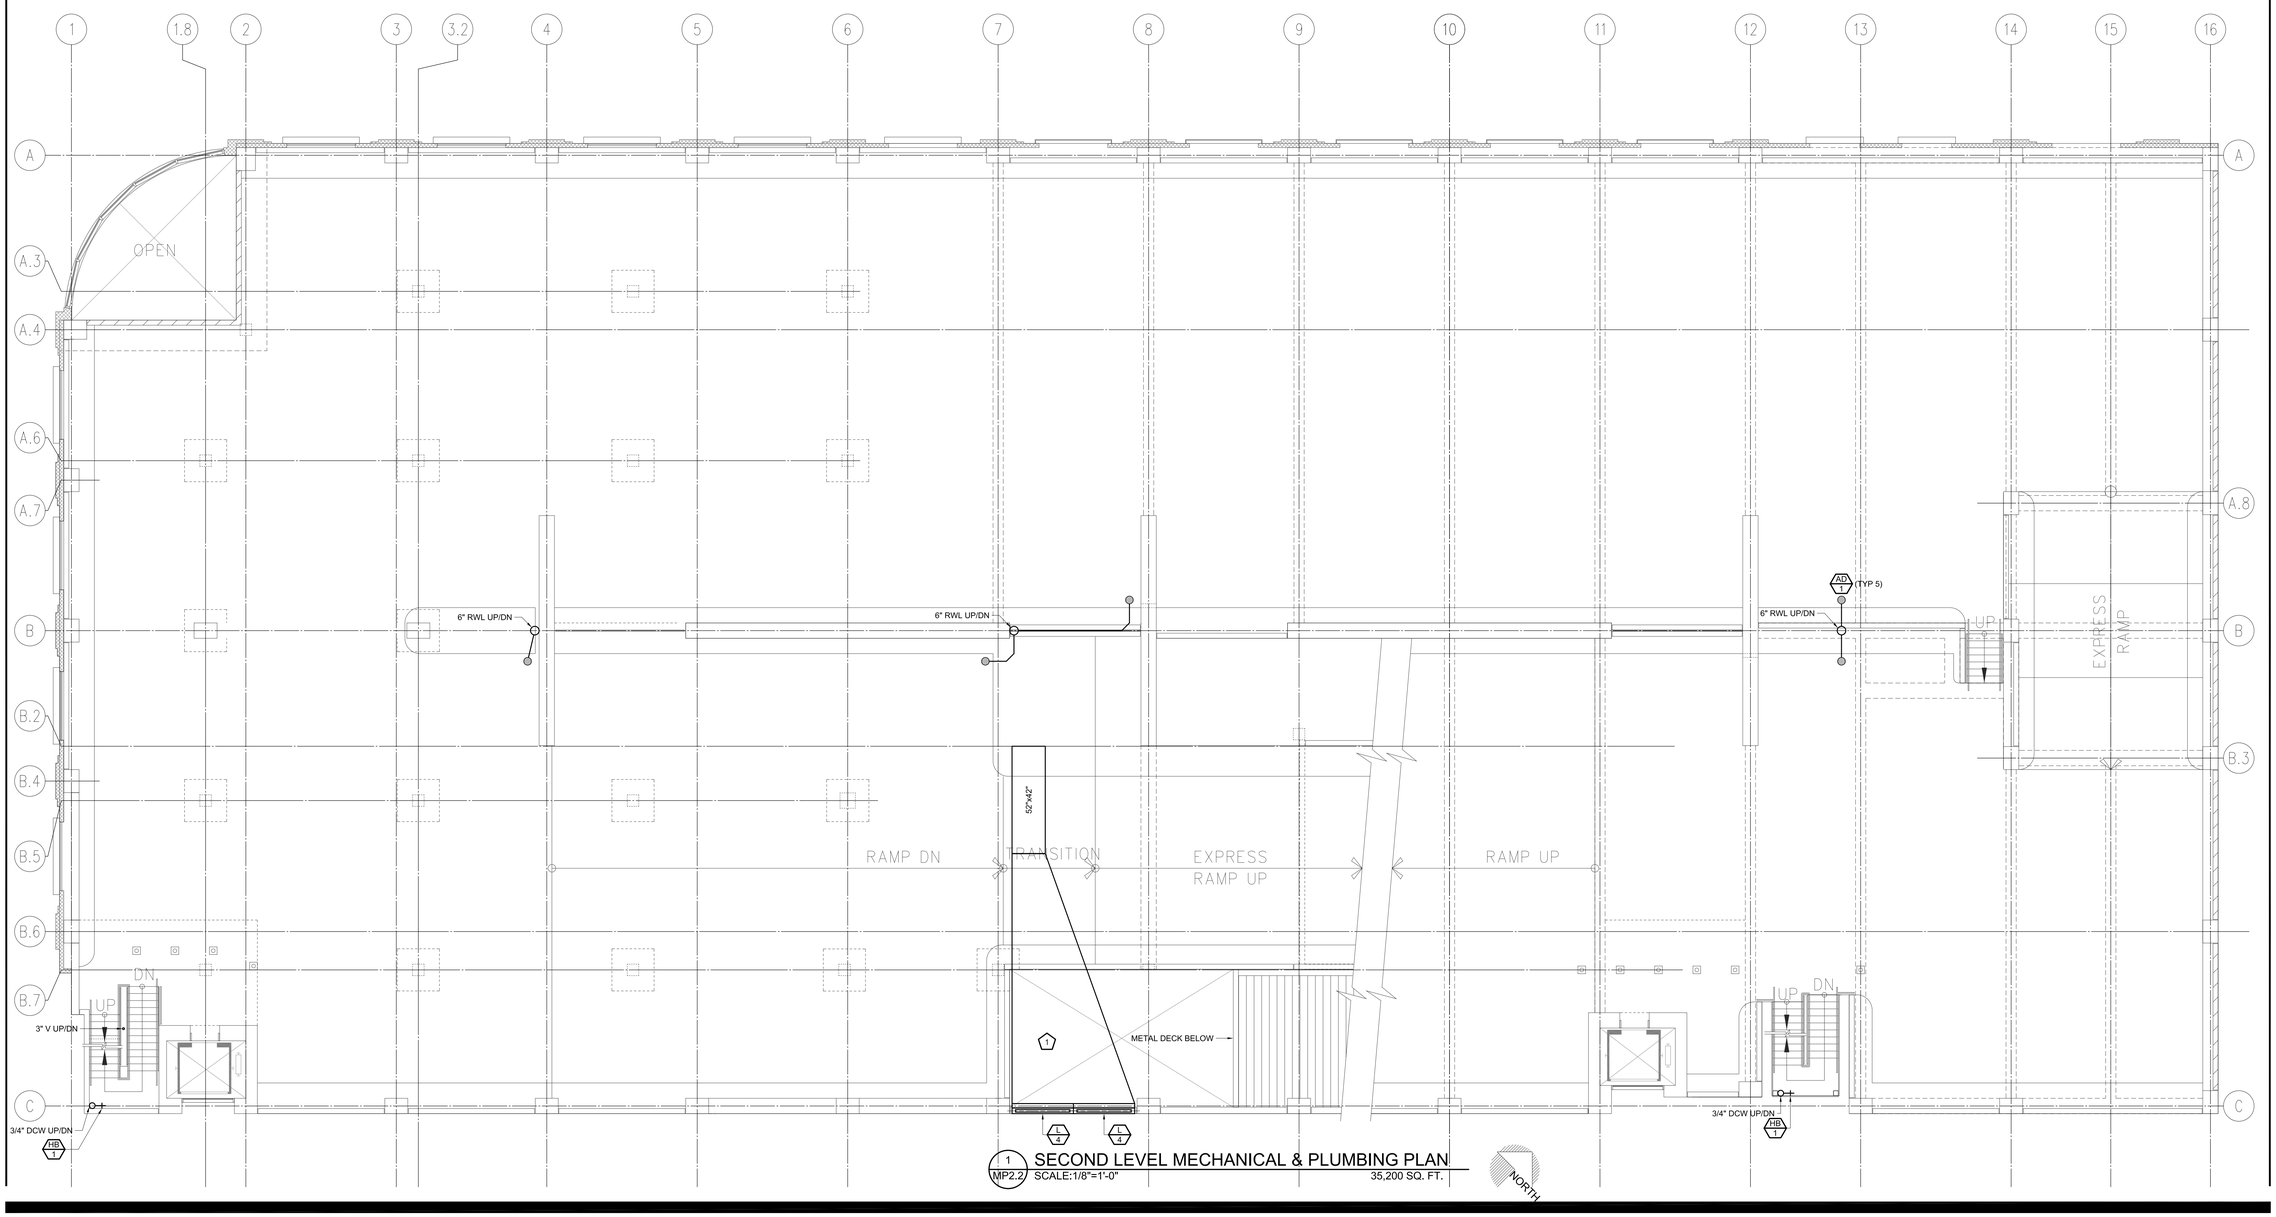


1 MP2.2 SECOND LEVEL MECHANICAL & PLUMBING PLAN
SCALE:1/8"=1'-0" 35,200 SQ. FT.

Architects • Engineers • Parking Planners

WATRY DESIGN, INC.

1700 Seaport Blvd, Suite 210
Redwood City, California 94063
Tel: 650.298.8150
Fax: 650.298.8151
E-mail: wdi@watrydesign.com
www.watrydesign.com

LIST ENGINEERING COMPANY
9699 Blue Larkspur Lane
Suite 203
Monterey, CA 93940
Telephone 831.373.4390
Facsimile 831.373.6322
Job No. - 03001.00

© LEC 2005

PD021105

NOT FOR CONSTRUCTION

SECOND LEVEL MECHANICAL & PLUMBING PLAN

# MOUNTAIN VIEW PARKING STRUCTURE

MOUNTAIN VIEW, CALIFORNIA

| REVISIONS | | |
|---|---|---|
| NO. | DATE | BY |
| | | |

02-24-05
80% WORKING DOCUMENTS

| | | |
|---|---|---|
| JOB NO | : | 02044 |
| DATE | : | 12-06-04 |
| DESIGN | : | J. CANTER |
| DRAWN | : | D. CUSTIS |
| CHECKED BY | : | R. BLUE |
| FILE NAME | : | MP2.2.DWG |

SHEET

MP2.2

\\Lacsrv-2\CAD\PROJECTS\2003\03011\MP2.3.dwg, 2/22/2005 9:24:54 AM, daniel

© WATRY DESIGN, INC. 2003

PRELIMINARY
FOR REVIEW PURPOSES ONLY

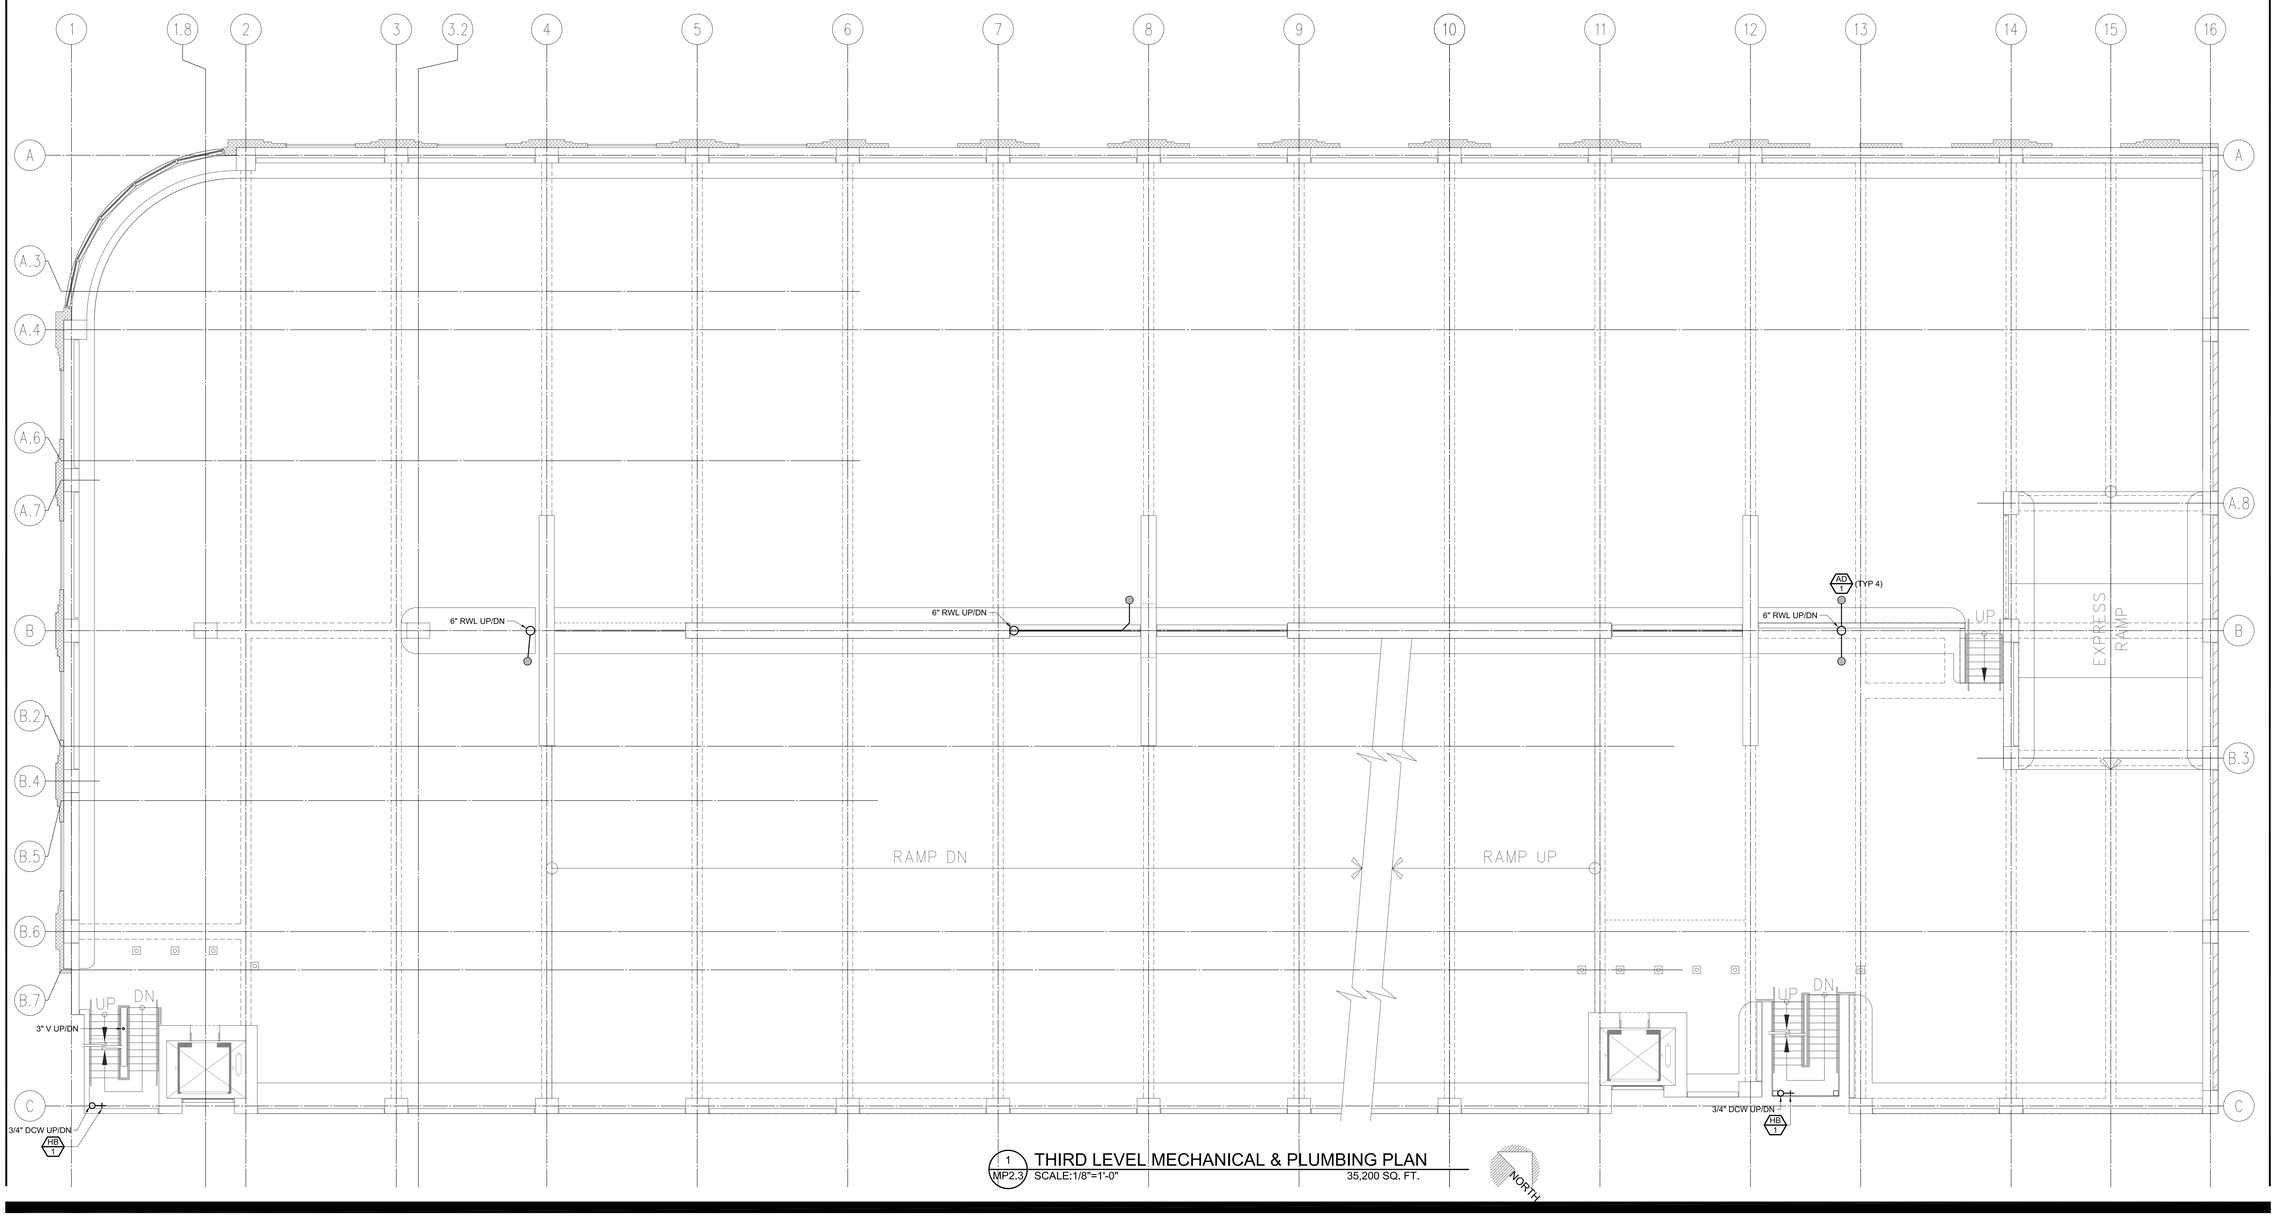


1 MP2.3 THIRD LEVEL MECHANICAL & PLUMBING PLAN
SCALE:1/8"=1'-0" 35,200 SQ. FT.

Architects • Engineers • Parking Planners

WATRY DESIGN, INC.

1700 Seaport Blvd, Suite 210
Redwood City, California 94063
Tel: 650.298.8150
Fax: 650.298.8151
E-mail: wdi@watrydesign.com
www.watrydesign.com

LIST ENGINEERING COMPANY
9699 Blue Larkspur Lane
Suite 203
Monterey, CA 93940
Telephone 831.373.4390
Facsimile 831.373.6322
Job No. - 03001.00

© LEC 2005

PD021105

NOT FOR CONSTRUCTION

THIRD LEVEL MECHANICAL & PLUMBING PLAN

# MOUNTAIN VIEW PARKING STRUCTURE

MOUNTAIN VIEW, CALIFORNIA

REVISIONS

| NO. | DATE | BY |
|---|---|---|
| | | |

02-24-05
80% WORKING DOCUMENTS

| | | |
|---|---|---|
| JOB NO | : | 02044 |
| DATE | : | 12-06-04 |
| DESIGN | : | J. CANTER |
| DRAWN | : | D. CUSTIS |
| CHECKED BY | : | R. BLUE |
| FILE NAME | : | MP2.3.DWG |

SHEET

MP2.3

\\Lacsrv-2k\CAD\PROJECTS\2003\03011\MP2.4.dwg, 2/22/2005 9:24:23 AM, daniel

© WATRY DESIGN, INC. 2003

PRELIMINARY
FOR REVIEW PURPOSES ONLY

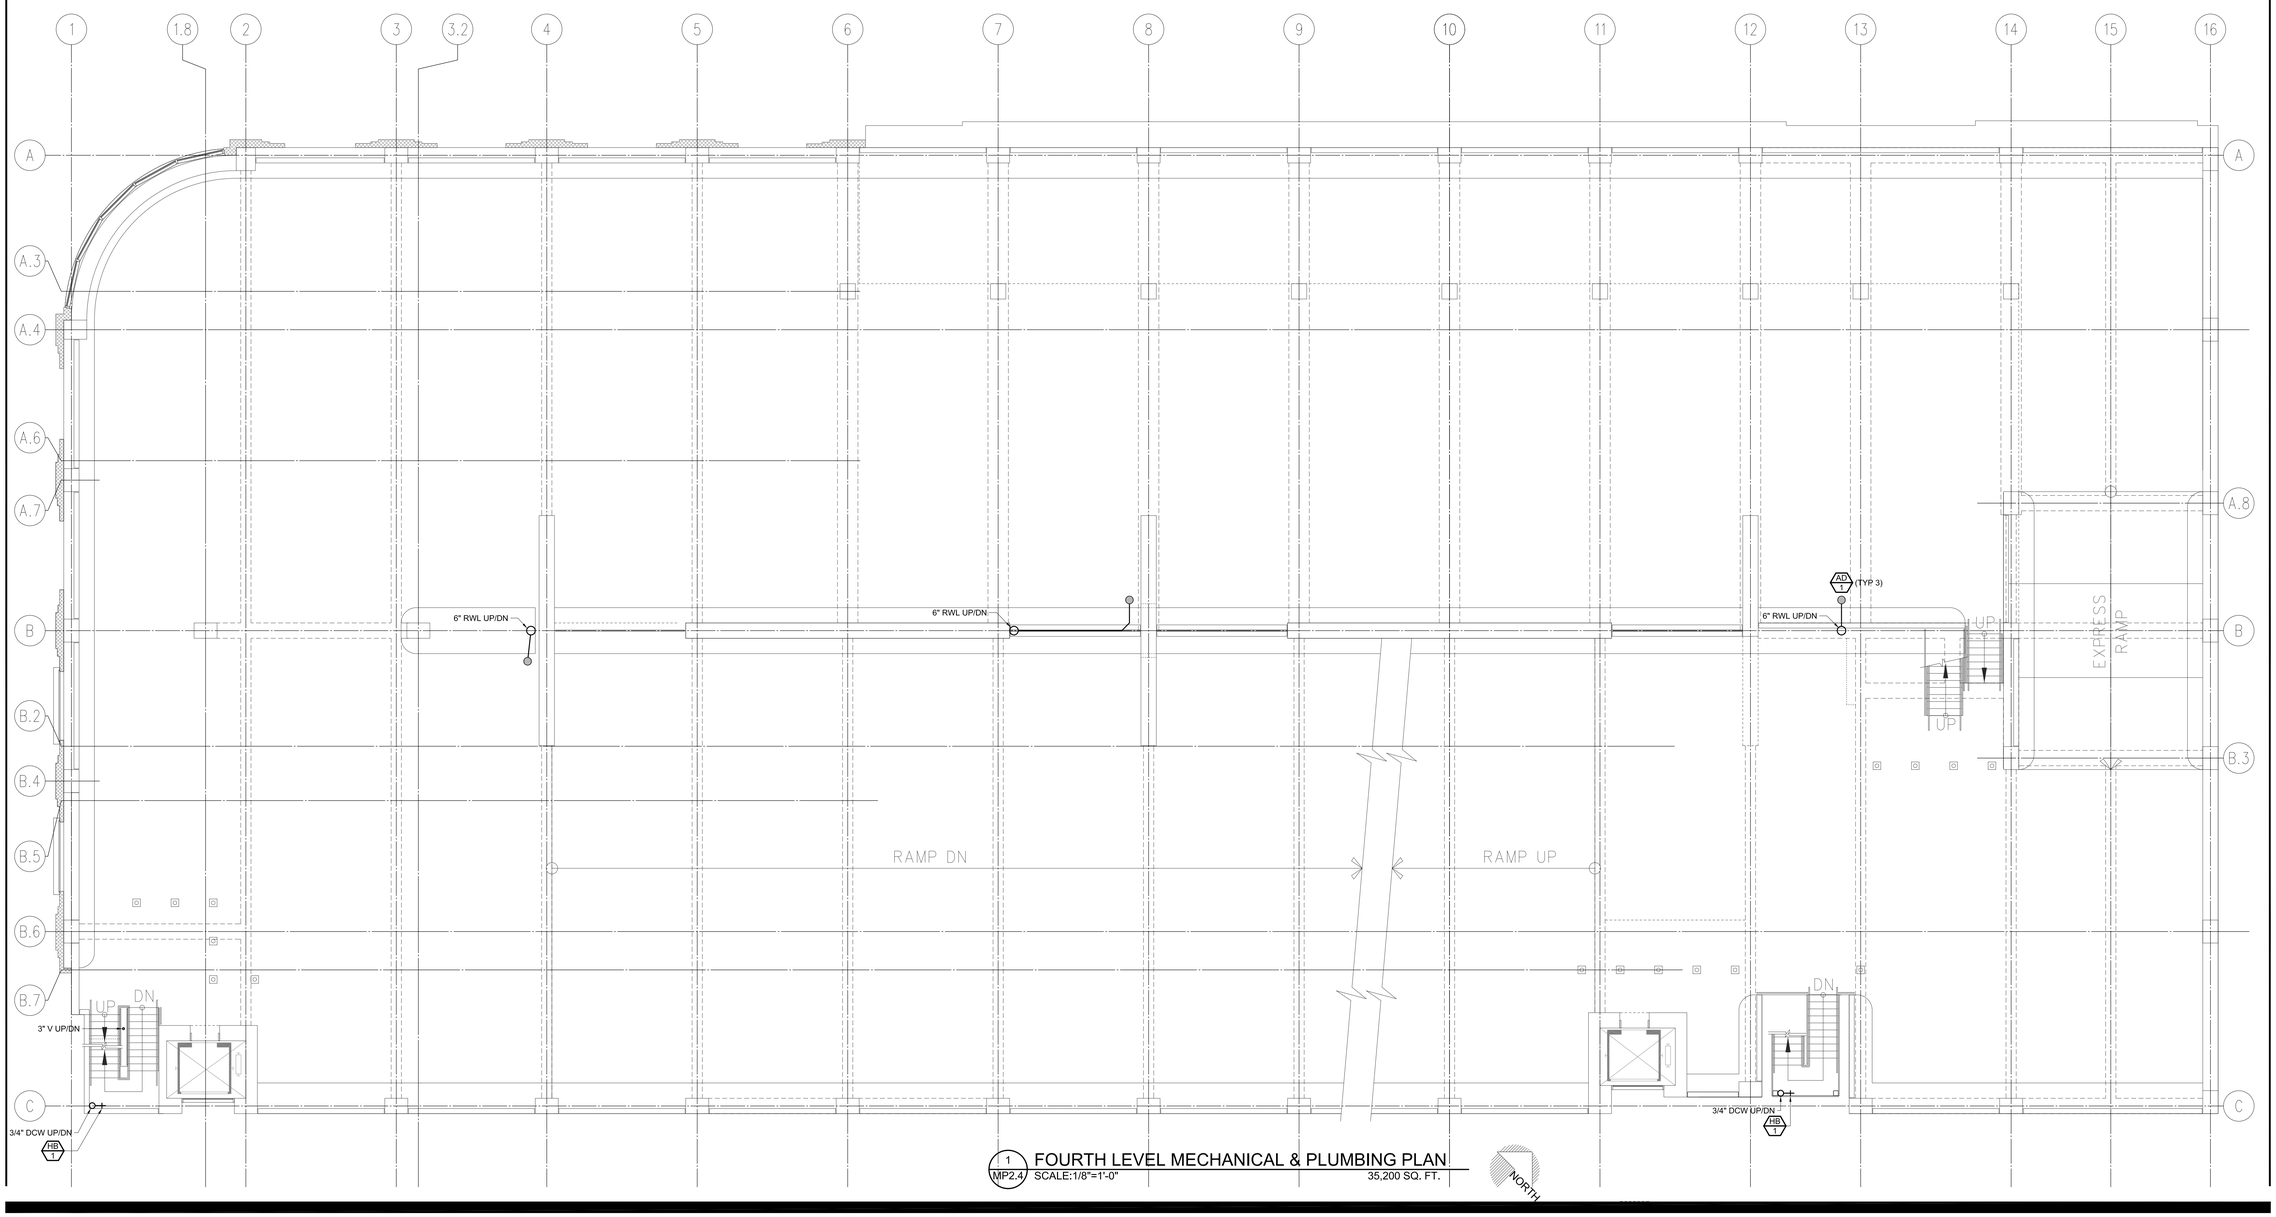


1 MP2.4 FOURTH LEVEL MECHANICAL & PLUMBING PLAN
SCALE:1/8"=1'-0" 35,200 SQ. FT.

NORTH

Architects • Engineers • Parking Planners

WATRY DESIGN, INC.

1700 Seaport Blvd, Suite 210
Redwood City, California 94063
Tel: 650.298.8150
Fax: 650.298.8151
E-mail: wdi@watrydesign.com
www.watrydesign.com

LIST ENGINEERING COMPANY
9699 Blue Larkspur Lane
Suite 203
Monterey, CA 93940
Telephone 831.373.4390
Facsimile 831.373.6522
Job No. - 03001.00

© LEC 2005

PD021105

NOT FOR CONSTRUCTION

FOURTH LEVEL MECHANICAL & PLUMBING PLAN

# MOUNTAIN VIEW PARKING STRUCTURE

MOUNTAIN VIEW, CALIFORNIA

REVISIONS

| NO. | DATE | BY |
|---|---|---|
| | | |

02-24-05
80% WORKING DOCUMENTS

| | | |
|---|---|---|
| JOB NO | : | 02044 |
| DATE | : | 12-06-04 |
| DESIGN | : | J. CANTER |
| DRAWN | : | D. CUSTIS |
| CHECKED BY | : | R. BLUE |
| FILE NAME | : | MP2.4.DWG |

SHEET

MP2.4

\\Lecserv2\CAD\PROJECTS\2003\03011\MP2.5.dwg, 2/22/2005 9:27:29 AM, daniel

© WATRY DESIGN, INC. 2003

PRELIMINARY
FOR REVIEW PURPOSES ONLY

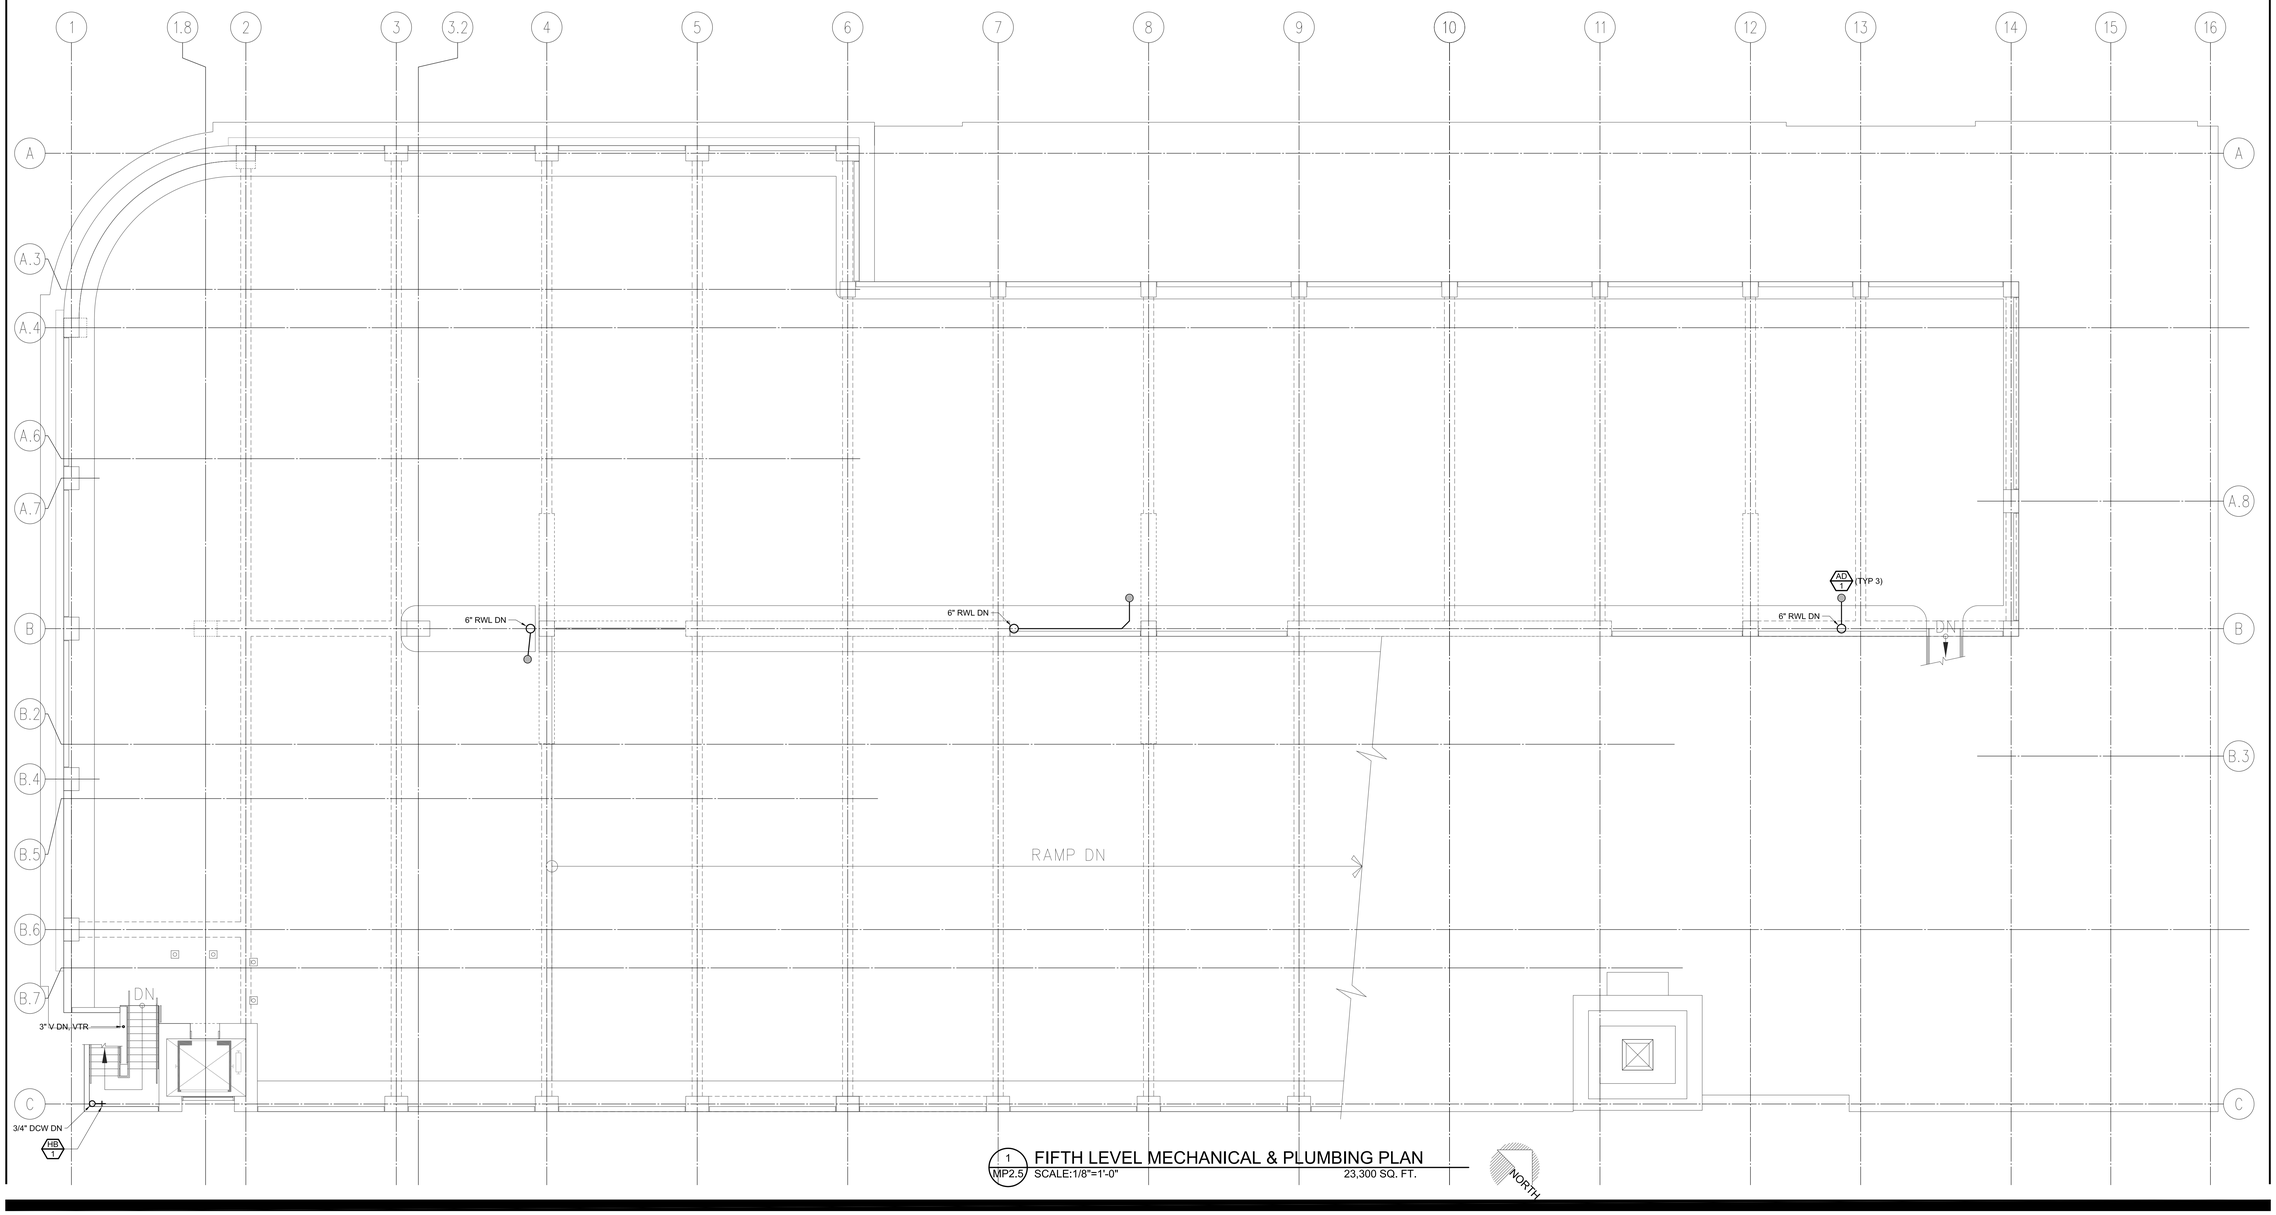


1 MP2.5 FIFTH LEVEL MECHANICAL & PLUMBING PLAN
SCALE:1/8"=1'-0"
23,300 SQ. FT.

NORTH

Architects • Engineers • Parking Planners

WATRY DESIGN, INC.

1700 Seaport Blvd, Suite 210
Redwood City, California 94063
Tel: 650.298.8150
Fax: 650.298.8151
E-mail: wdi@watrydesign.com
www.watrydesign.com

LIST ENGINEERING COMPANY
9699 Blue Larkspur Lane
Suite 203
Monterey, CA 93940
Telephone 831.373.4390
Facsimile 831.373.6522
Job No. - 03001.00

© LEC 2005

PD021105

NOT FOR CONSTRUCTION

FIFTH LEVEL MECHANICAL & PLUMBING PLAN

# MOUNTAIN VIEW PARKING STRUCTURE

MOUNTAIN VIEW, CALIFORNIA

REVISIONS

| NO. | DATE | BY |
|---|---|---|
| | | |

02-24-05
80% WORKING DOCUMENTS

| | | |
|---|---|---|
| JOB NO | : | 02044 |
| DATE | : | 12-06-04 |
| DESIGN | : | J. CANTER |
| DRAWN | : | D. CUSTIS |
| CHECKED BY | : | R. BLUE |
| FILE NAME | : | MP2.5.DWG |

SHEET

MP2.5